



Certificate of Compliance

Certificate Number: LR 13631-359


Revision:

Date Issued: November 28, 1997

Issued to: Phoenix Contact Inc.
P.O. Box 4100
Harrisburg, PA 17111 U.S.A.
Att: Mr. Kurt Boegli

The products listed below are eligible to bear the CSA Mark

Issued by: S. Clark, C.E.T.
Etobicoke, ON Canada

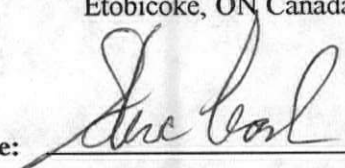Signature: 

CLASS 6228 01 - WIRE CONNECTING DEVICES - Terminal Assemblies

PRODUCTS

Terminal blocks, Cat No URTK/SP, rated 45A, 300V, torque 14.2inlb, for use with Nos 26-8 AWG solid or stranded copper conductors.

APPLICABLE REQUIREMENTS

CSA Std C22.2 No. 158-1987 - Terminal Blocks



Supplement to Certificate of Compliance

Certificate Number: LR 13631-359

Issued to: Phoenix Contact Inc.
P.O. Box 4100
Harrisburg, PA 17111 U.S.A.
Att: Mr. Kurt Boegli

*The products listed, including the latest revision described below,
are eligible to be marked in accordance with the referenced Certificate.*

Issued By: S. Clark, C.E.T.
Etobicoke, ON Canada

Signature

Product Certification History

Revision	Date	Description
-359	Nov 28, 1997	Original Certification.



Descriptive and Test Report


Montréal ■ Toronto ■ Edmonton ■ Vancouver ■ Tokyo ■ Hong Kong

REPORT NO: LR 13631-359

Edition 1: November 28, 1997; Application No LR 13631-359 - Etobicoke
Issued by S. Clark, C.E.T.

Certificate of Compliance has been issued.

Contents: Pages - 1 to 5
Figures - 1

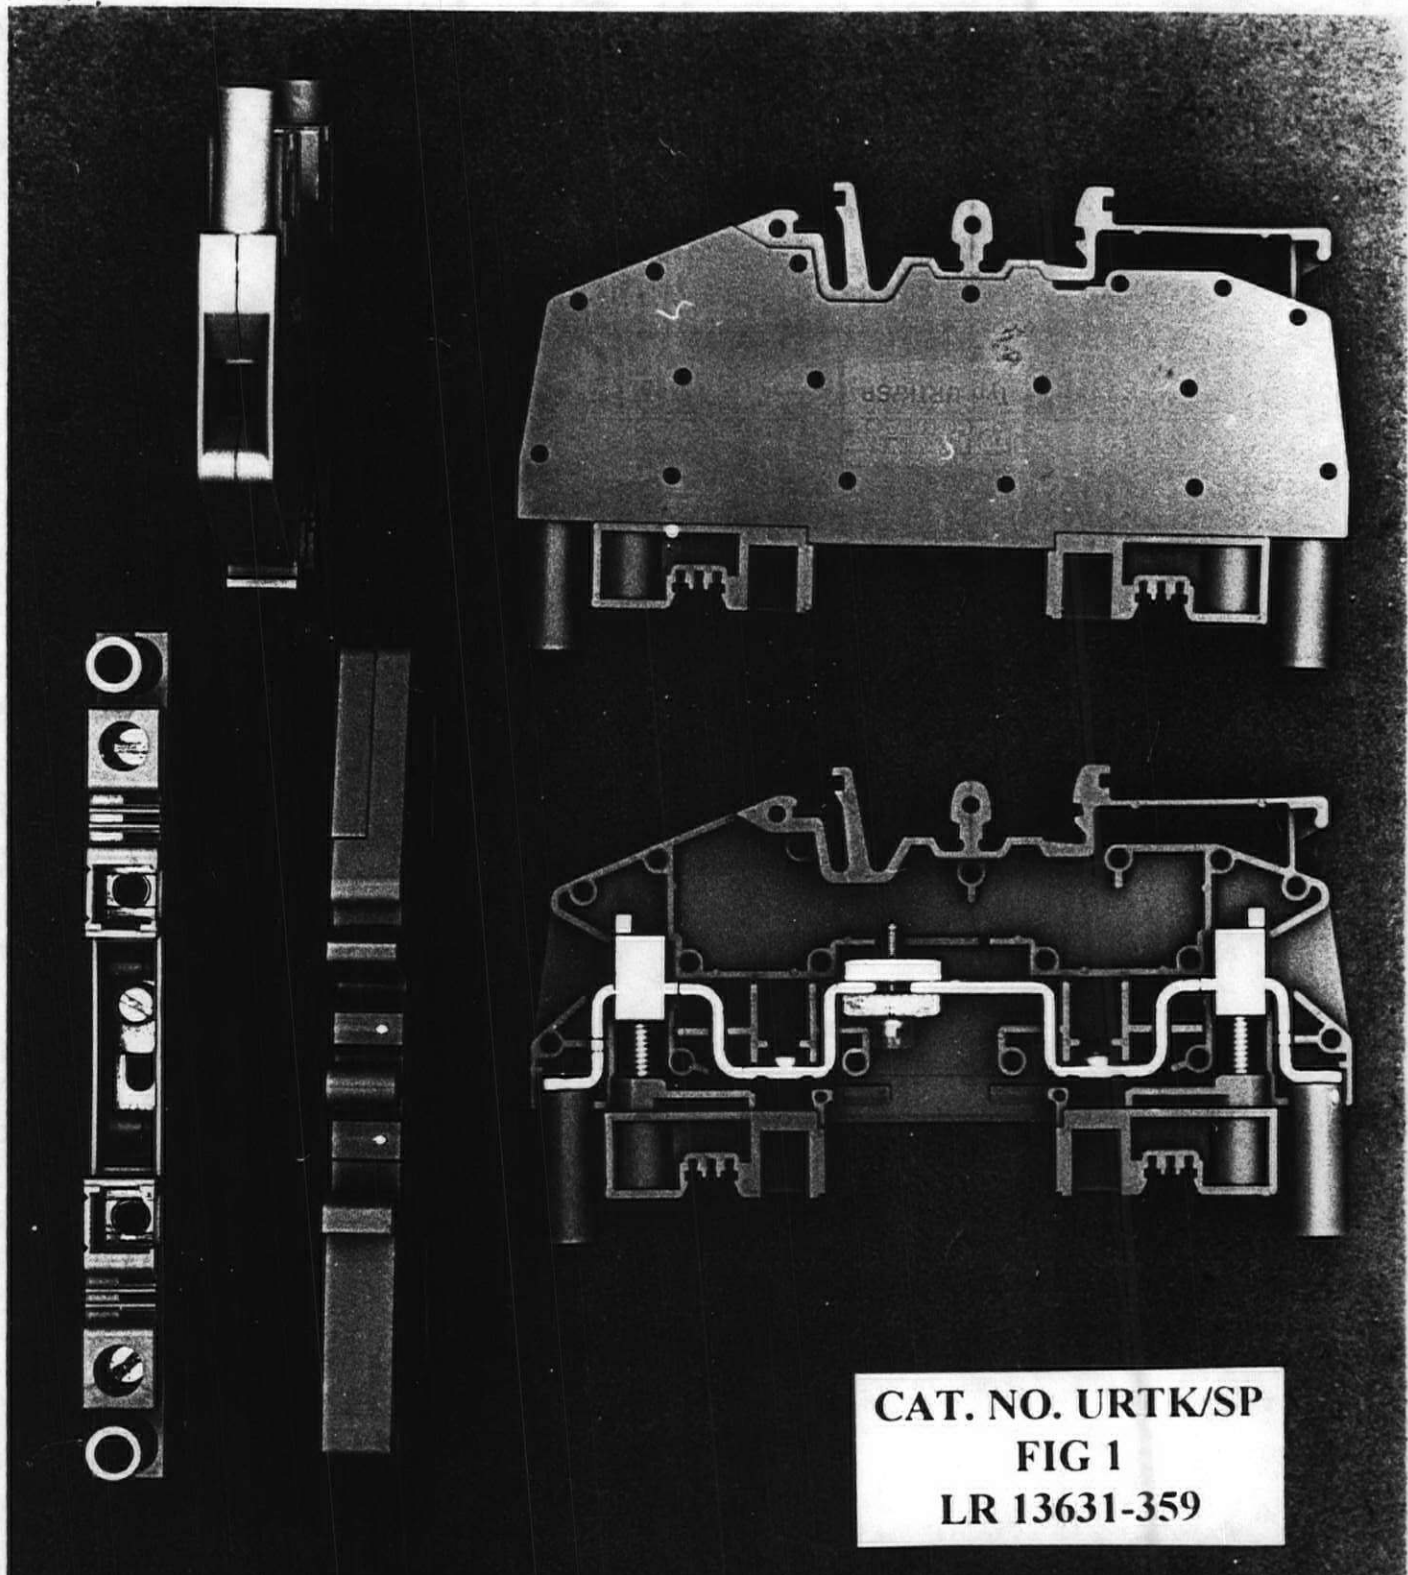

CAT. NO. URTK/SP
FIG 1
LR 13631-359

